

SEATTLE CITY LIGHT
MATERIAL STANDARD

STANDARD NUMBER: **2549.8**
 PAGE: 1 of 1
 DATE: September 1, 1976
 REV: March 23, 2000

HANDLE EXTENSION: 4 & 26kV SWITCHES

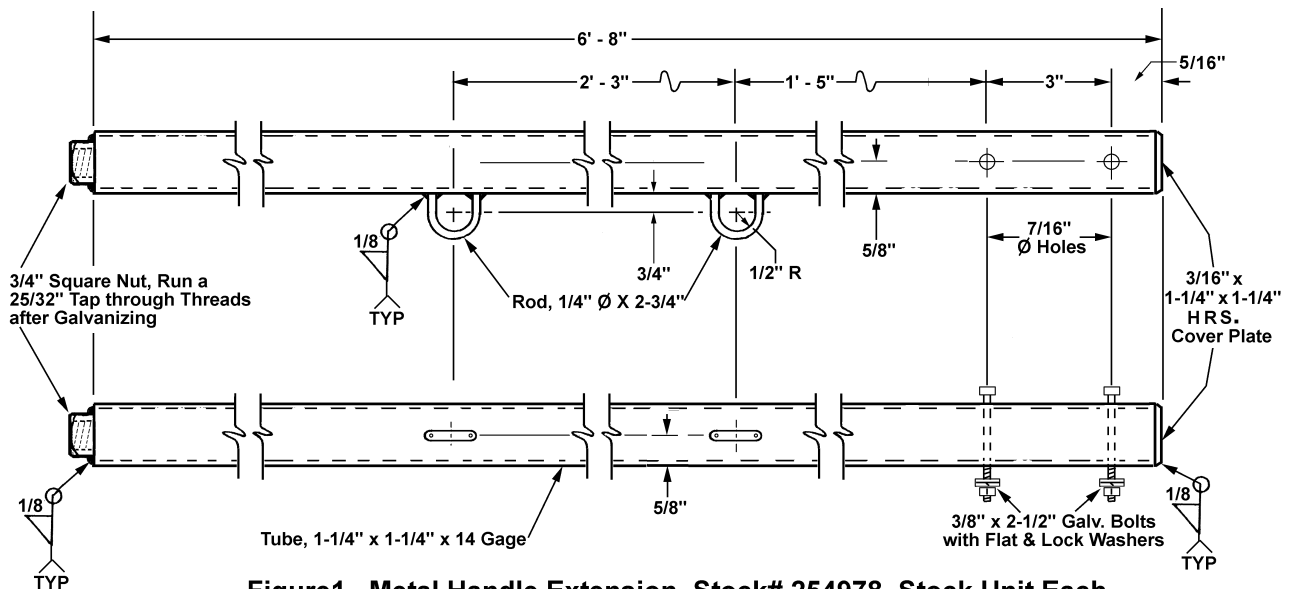


Figure1. Metal Handle Extension. Stock# 254978 Stock Unit Each

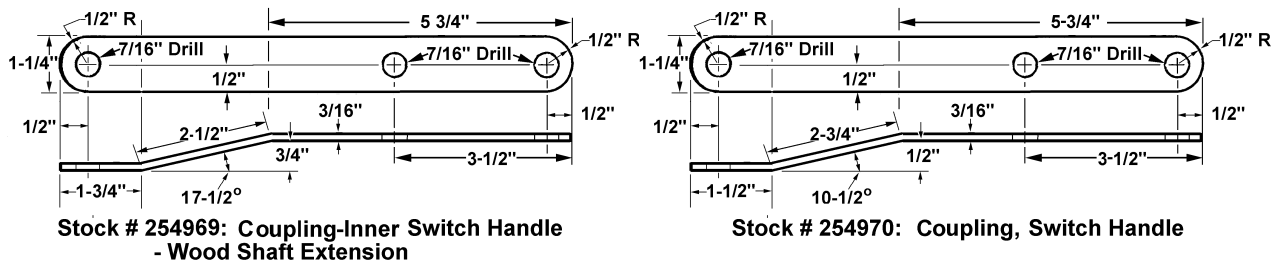


Figure 2. Extension Couplings. Stock Unit: Pair




Figure 3. 4 & 26kV Switch Handle Extension Assembly

All metal parts shall be of the configuration and dimensions shown. They shall be made of steel that conforms to ASTM A36 and shall be free of rough or uneven surfaces and edges. All parts shall be galvanized after fabrication in accordance with ASTM A123.

Reference Specifications: ASTM A36 and ASTM A123.

| ORIGINATOR | STANDARDS COORDINATOR | STANDARDS SUPERVISOR | UNIT DIRECTOR |
|--------------------|---------------------------|-----------------------|-------------------|
| <i>Jim S. Horn</i> | <i>Charles L. Shaffer</i> | <i>John C. Hinner</i> | <i>Betty Robm</i> |